


150 WATT HIGH PRESSURE SODIUM
TEST NO. HP-01146

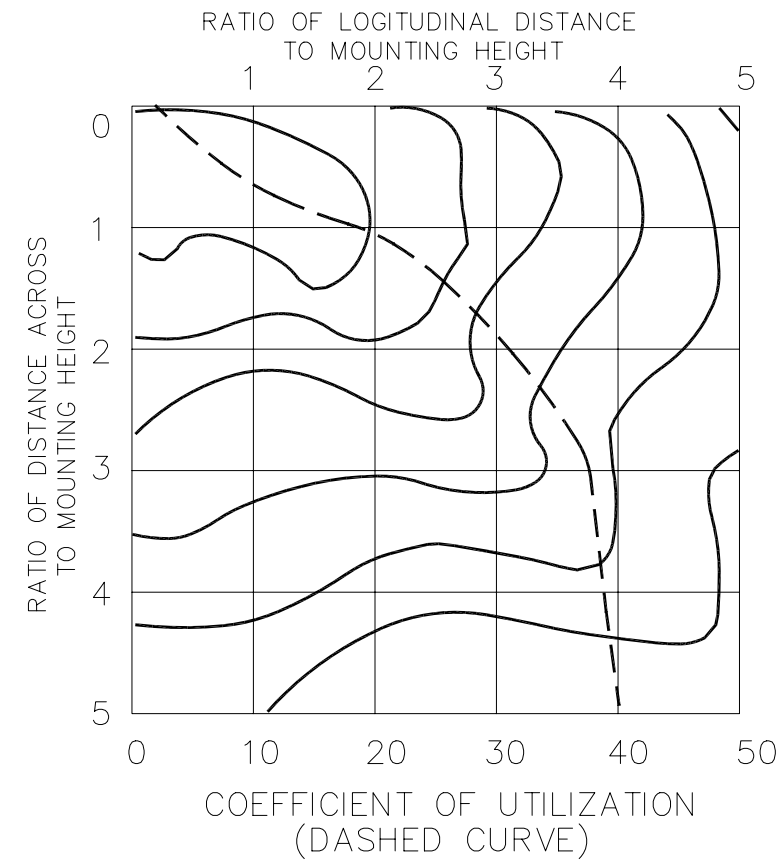

TO DETERMINE FOOTCANDLE VALVES FOR 70 WATT HPS AND 100 WATT HPS MULTIPLY BT .36 AND .59 RESPECTIVELY

BASED ON 15-FOOT MOUNTING HEIGHT

EXTERIOR HIGH PRESSURE SODIUM LUMINAIRE
SUITABLE FOR WET LOCATIONS

HIGH PRESSURE SODIUM FIZTURE WITH BALLAST. SHALL BE CLASS "H" INSULATED -20 DEGREES F STARTING, 60 Hz. REGULATED HIGH POWER FACTOR TYPE. UNIT SHALL BE UL LISTED AS "SUITABLE FOR WET LOCATIONS."

BACK HOUSING SHALL BE ONE-PIECE DIE-CAST ALUMINUM. FRONT ACCESS DOOR AND PRIMASTIC LENS SHALL BE ONE-PIECE, VANDAL RESISTANT INJECTION MOLDED U.V. STABILIZED POLYCARBONATE. FURNISH HUBBELL PERMALITER CAT. NO. PVL-01005-11X OR APPROVED EQUAL.

FURNISH WITH PHOTOCONTROL
LAMP

11-3-88
HPS-8

1-100W HIGH PRESSURE SODIUM
LAMP, BT-25
CLASS H, -20 DEGREE STARTING