

Recreation Management Tech Tips

United States Department of Agriculture
Forest Service



**Technology &
Development Program**

April 2005

2300

0523 1301—SDTDC

Using Vitamin C To Neutralize Chlorine in Water Systems

Brenda Land, Sanitary Engineer, Project Leader

INTRODUCTION

The purpose of this report is to summarize a study on using vitamin C to neutralize chlorine in water. The intended audience is sanitary engineers and operators of water and wastewater systems.

Operators of seasonal water systems sanitize spring-boxes or wells, storage tanks (figure 1), and distribution lines with a strong chlorine solution. After these operators sanitize the water systems, they must waste the chlorinated water. Chlorine can kill fish and other aquatic organisms. Therefore, operators must neutralize the chlorinated water before discharging the water into lakes or streams. The chlorinated water needs neutralizing if the wasted water goes to a septic system or small wastewater treatment plant, because chlorine can upset the bacterial balance in the system. Even very low levels of chlorine will harm or destroy aquatic organisms and beneficial bacteria. Operators need a permit from their State regulatory agency before discharging any treated or altered water to navigable waters of the United States or into a publicly owned wastewater treatment plant.

CURRENT METHODS OF DECHLORINATION

Passive Methods

There are several passive methods for neutralizing chlorine. Operators may hold chlorinated water in a tank or pond until the chlorine dissipates because air and sunlight will neutralize chlorine over



Figure 1—Storage tanks.

time. Operators may discharge the chlorinated water into soil, a road surface, or ditch, where the chlorine will react positively with organic and inorganic impurities. As long as the wasted water does not enter a lake or stream before the chlorine is neutralized, passive dechlorination (neutralization of chlorine) is preferable to chemical dechlorination.

Chemical Methods

Chemical methods of dechlorinating water are faster than passive methods. Water system operators may use sulfur compounds to dechlorinate water. However, to properly neutralize chlorinated water, operators need both caution and experience when using sulfur-based chemicals (Hill 2003). Sulfur-based chemicals are oxygen



For additional information, contact: Recreation Management Program Leader, San Dimas Technology & Development Center, 444 East Bonita Avenue, San Dimas, CA 91773-3198; Phone 909-599-1267; TDD; 909-599-2357; FAX: 909-592-2309
Lotus Notes: Mailroom WO SDTDC@FSNOTES • Intranet (web site): <http://fsweb.sdtdc.wo.fs.fed.us> • Internet e-mail: mailroom_wo_sdtdc@fs.fed.us


scavengers that will lower the dissolved oxygen in the receiving lake or stream, and some sulfur compounds are hazardous chemicals. At least two studies suggest that chlorinated and sulfonated water (sulfur-based dechlorination) poses a hazard to some sensitive aquatic species (Hall and others 1982; Rein and others 1992).

VITAMIN C DECHLORINATION

Vitamin C is a newer chemical method for neutralizing chlorine. Two forms of vitamin C, ascorbic acid and sodium ascorbate, will neutralize chlorine. Neither is considered a hazardous chemical. First, vitamin C does not lower the dissolved oxygen as much as sulfur-based chemicals do. Second, vitamin C is not toxic to aquatic life at the levels used for dechlorinating water. Although ascorbic acid is mildly acidic and, in large doses, will lower the pH of the treated water, sodium ascorbate is neutral and will not affect the pH of the treated water or the receiving stream. Both forms of vitamin C are stable, with a shelf life of at least 1 year in a dry form if kept in a cool, dark place. Once it is placed in solution, however, vitamin C degrades in a day or two.

Ascorbic Acid

One gram of ascorbic acid will neutralize 1 milligram per liter of chlorine per 100 gallons of water. The reaction is very fast. The chemical reaction (Tikkanen and others 2001) of ascorbic acid with chlorine is shown below:



Ascorbic acid + Hypochlorous acid →
Dehydroascorbic acid + Hydrochloric acid + water


Approximately 2.5 parts of ascorbic acid are required for neutralizing 1 part chlorine. Since ascorbic acid is weakly acidic, the pH of the treated water may decrease slightly in low alkaline waters.

Sodium Ascorbate

Sodium ascorbate will also neutralize chlorine. It is pH neutral and will not change the pH of the treated water. Sodium ascorbate is preferable for neutralizing high concentrations of chlorine. If a large amount of treated water is going to be

discharged to a small stream, the pH of the treated water and the stream should be within 0.2 to 0.5 units of the receiving stream.

The reaction (Tikkanen and others 2001) of sodium ascorbate with chlorine is shown below:



Sodium ascorbate + Hypochlorous acid →
Dehydroascorbic acid + Sodium chloride + water

Approximately 2.8 parts of sodium ascorbate are required to neutralize 1 part chlorine. When vitamin C is oxidized, a weak acid called dehydroascorbic acid forms.

Several studies have evaluated the use of ascorbic acid and sodium ascorbate to neutralize low levels of chlorine—less than 2 milligrams per liter. Only one study (Tacoma Water Utility Report) evaluated the use of ascorbic acid to neutralize high levels of chlorine—up to 100 milligrams per liter. The Tacoma, WA, Water Utility Engineer recommends against using ascorbic acid to neutralize high levels of chlorine in large volumes of water because it lowers the pH of the treated water. The Tacoma Water Utility engineer recommends using sodium ascorbate instead.



Figure 2—Ascorbic acid is used to neutralize chlorine.

The San Dimas Technology and Development Center project leader set up a small experiment to evaluate water changes during the use of sodium ascorbate or ascorbic acid to neutralize a strong chlorine solution (figure 2). The experiment consisted of:

- Making a strong chlorine solution (approximately 50 milligrams per liter chlorine).
- Neutralizing the chlorine solution with either ascorbic acid or sodium ascorbate.
- Monitoring pH, temperature, dissolved oxygen, total chlorine, and free chlorine after each step.

Tables 1 and 2 show the results.

Test equipment:

pH	Hach EC10 pH meter with temperature compensation
Dissolved Oxygen	DR/890 Colorimeter with Accuvac ampoules
Chlorine	DR/890 Colorimeter, DPD method (Dilution used for chlorine level over 5 milligrams per liter)

Both ascorbic acid and sodium ascorbate lowered the dissolved oxygen level of the treated water at

this dose, as tables 1 and 2 show. The sodium ascorbate also affected the pH level, although not as much as with ascorbic acid.

The project leader put a submersible pump in the aquarium treated with sodium ascorbate to raise the dissolved oxygen level and put mosquito fish *Gambusia affinis* in the tank. The fish remained alive and in no distress after 24 hours (see figure 3).

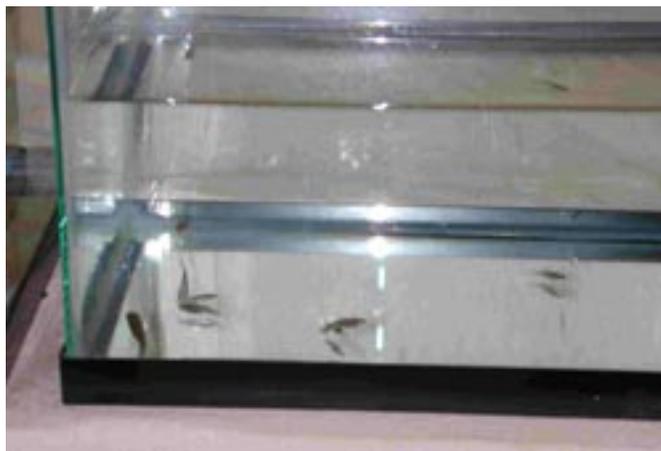


Figure 3—*Gambusia affinis* swim in fish tank treated with vitamin C.

Table 1—Ascorbic acid

Ascorbic Acid	pH	Temperature (°C)	Dissolved Oxygen (mg/L)	Total Chlorine (mg/L)	Free Chlorine (mg/L)
5 gal tap water	7.6	22.3	8.3	0.75	0.05
+ 15 mL – 6% sodium chloride	8.0	21.7	9.7	66.6	47.8
+ 2.5 g ascorbic acid	6.2	21.1	5.7	0.00	0.02

Table 2—Sodium ascorbate

Sodium Ascorbate	pH	Temperature (°C)	Dissolved Oxygen (mg/L)	Total Chlorine (mg/L)	Free Chlorine (mg/L)
5 gal tap water	7.6	22.7	9.5	0.79	0.05
+ 15 mL – 6% sodium chloride	8.1	21.7	9.1	52.6	47.6
+ 2.8 g sodium ascorbate	7.0	21.1	6.7	0.02	0.00

Aquaculture and aquarium hobbyists use vitamin C in water to help keep fish healthy. They use levels up to 50 milligrams per liter of vitamin C to treat wounds in aquarium and farm-raised fish.

CONCLUSION

Vitamin C effectively neutralizes chlorine and is safer to handle than sulfur-based dechlorination chemicals. The sodium ascorbate form of vitamin C has less affect on pH than the ascorbic acid form. When neutralizing a strong chlorine solution, both forms of vitamin C will lower slightly the dissolved oxygen of the treated water. If passive dechlorination is not practical, we recommend a form of vitamin C.

REFERENCES

Environmental Protection Agency. 2000. Wastewater Fact Sheet. Dechlorination. EPA 832-F-00-022. Washington, DC: U.S. Environmental Protection Agency.

Hall, L.W., Jr.; Burton, D. R.; Graves, W.C.; and Margery, S.L. 1992. Environmental Science and Technology. 15:573-78.

Hill, M. 2003. Dechlorination – Vitamin C. Welcome, NC: North Carolina Rural Water Association.

Rein, D.A.; Jamesson, G.M.; and Montheith, R.A.1992. In: Water Environment Federation 65th Annual Conference and Exposition. Alexandria, VA: Water Environment Federation. pp 461-71.

Tikkanen, M.W.; Schroeter, J. H.; Leong, L.Y.C.; Ganesh, R. 2001. Guidance Manual For the Disposal of Chlorinated Water. AWWA Research Foundation Report 90863. Denver, CO: American Water Works Association.

Electronic copies of SDTDC's publications are available on the Internet at:

<http://www.fs.fed.us/eng/pubs/>

Forest Service and U.S. Department of the Interior Bureau of Land Management employees can view SDTDC's individual project pages on their internal computer network at:

<http://fsweb.sdtdc.wo.fs.fed.us/>

For additional information about using vitamin C to treat water, contact Brenda Land at SDTDC.

Phone: 909-599-1267 ext. 219

Fax: 909-592-2309

E-mail: bland@fs.fed.us

Information contained in this document has been developed for the guidance of employees of the Forest Service, United States Department of Agriculture (USDA), its contractors, and co-operating Federal and State agencies. The USDA assumes no responsibility for the interpretation or use of this information by other than its own employees. The use of trade, firm, or corporation names is for the information and convenience of the reader. Such use does not constitute and official evaluation, conclusion, recommendation, endorsement, or approval of any product or service to the exclusion of others that may be suitable. The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activi-



ties on the basis of race, color, national origin, sex, religion, age, disability, political beliefs, sexual orientation, or marital or family status. (Not all prohibited bases apply to all programs.) Persons with disabilities who require alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at 202-720-2600 (voice and TDD).

To file a complaint of discrimination, write USDA, Director, Office of Civil Rights, Room 326-W, Whitten Building, 1400 Independence Avenue, SW, Washington, D.C. 20250-9410 or call 202-720-5964 (voice and TDD). USDA is an equal opportunity provider and employer.