
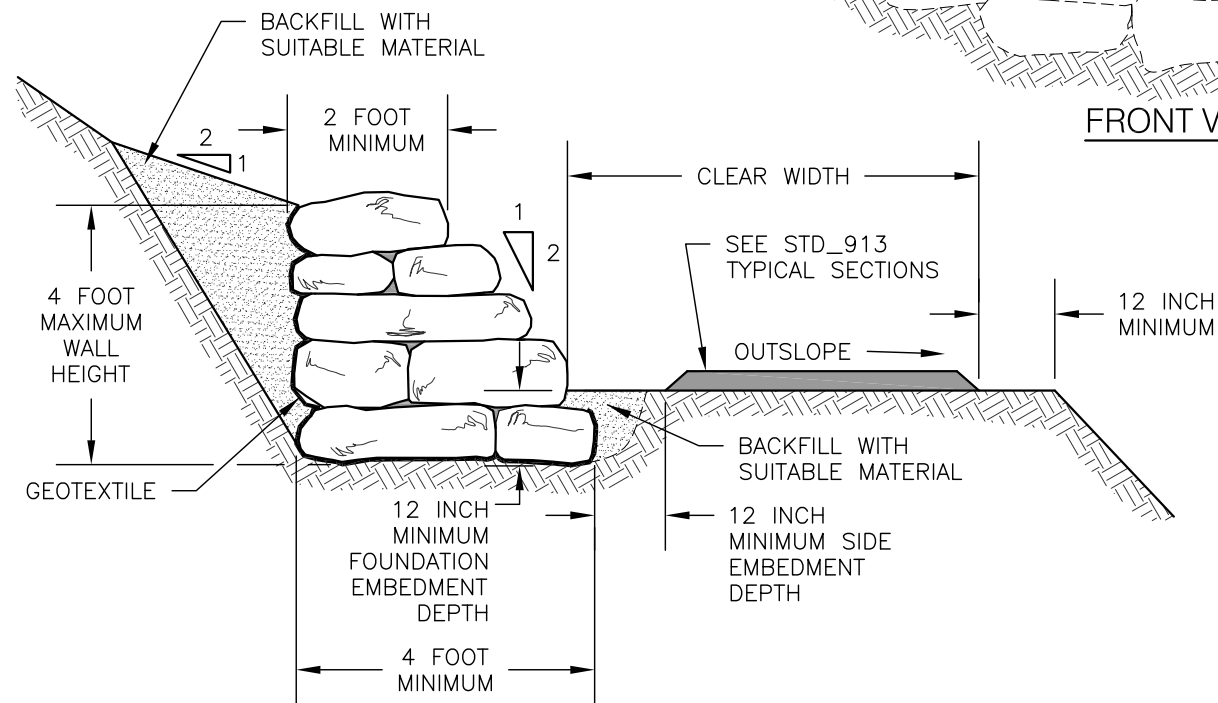



STACKED ROCK RETAINING WALL

TYPICAL ID	GEOTEXTILE TYPE	EMBEDMENT DEPTH		HEIGHT	COMMENTS
		FOUNDATION	SIDE		
RRW-1					

N/A WHEN NOT APPLICABLE

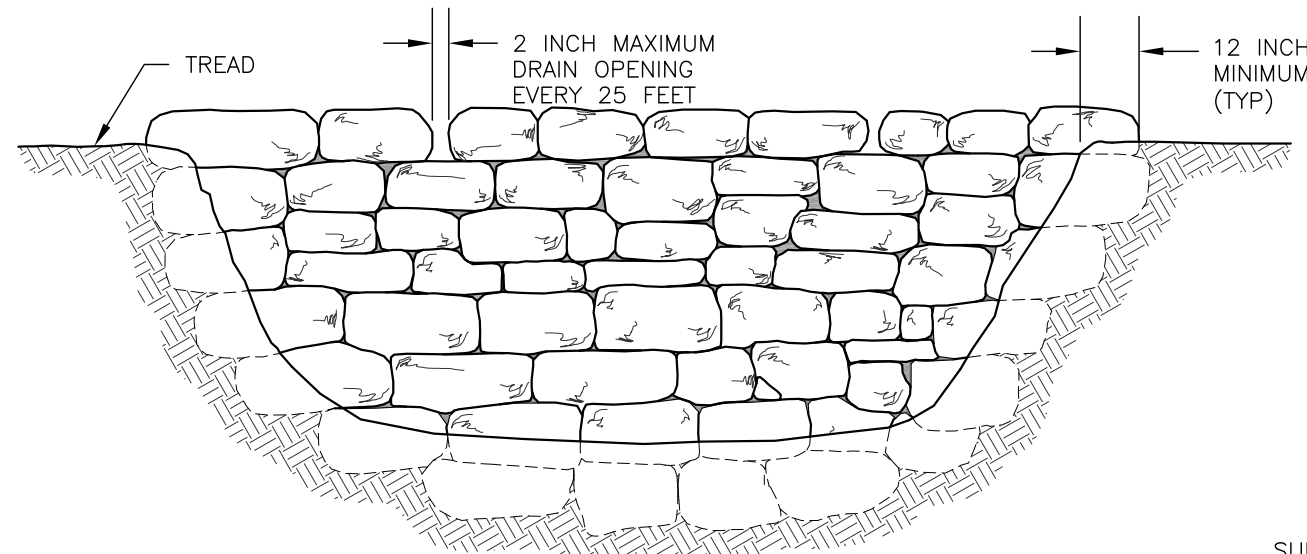

(A) UPHILL RETAINING WALL SECTION
SLOPE JOINTS INTO HILL.

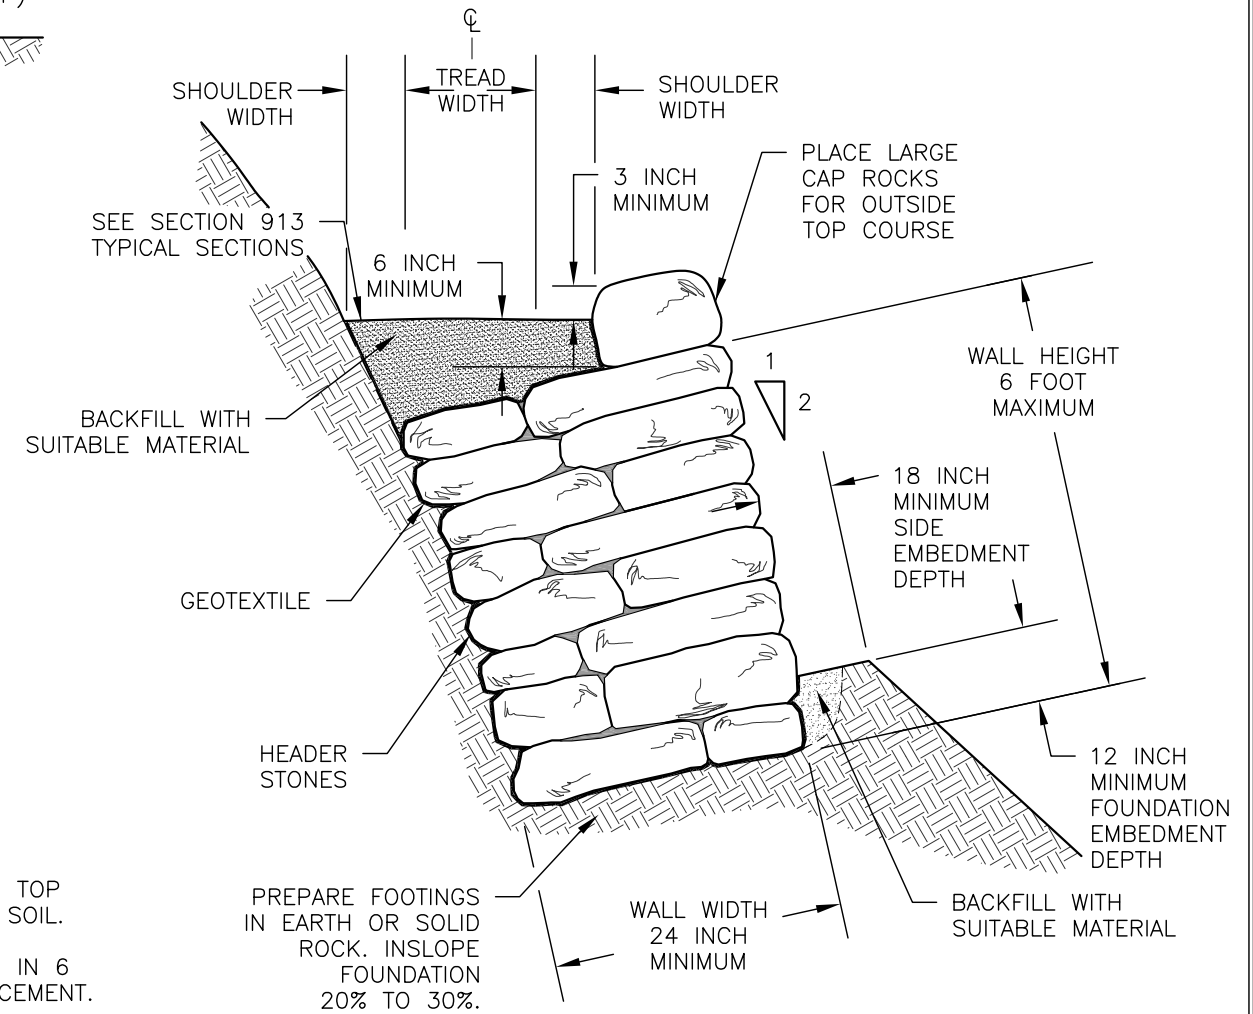

(B) UNDERTREAD RETAINING WALL SECTION
WALL WIDTH SHALL BE 2 FEET WIDE OR 1/2 THE WALL HEIGHT, WHICHEVER IS GREATER.

NOTES:

1. REMOVE AND DISPOSE OF DUFF AND TOP ORGANIC LAYERS DOWN TO MINERAL SOIL.
2. COMPACT BACKFILL AND FOUNDATION IN 6 INCH LIFTS UNTIL NO VISUAL DISPLACEMENT.
3. CLEAR WIDTH IS GREATER OR EQUAL TO THE TREAD AND SHOULDER WIDTHS DEFINED IN SECTION 911.